

Report No.:

Test Time: 2024/10/16

Luminaire Property

Luminaire Manufacturer: MESTER

Luminaire Category:

Luminaire Description: MALL012F20W27V27K-Down-100%

Lamp Catalog:

Number of Lamps: 1

Luminous Length (mm): 600

Luminous Height (mm):

Current: 0.172 A

Power Factor: 0.995

Lamp Description:

Lumens per Lamp:

Luminous Width (mm): 63

Voltage: 120.1 V

Power: 20.64 W

Photometric Results

CIE Class: Direct

Measurement Flux: 2582.1 lm

Downward Ratio: 100%

Horizontal Diffuse Angle(10%,50%,75%,100%): H93.7,H65.1,H45,H1

Vertical Diffuse Angle(10%,50%,75%,100%): V84.5,V63,V47.7,V2

Luminous Efficacy (lm/w): 125.10

Max. Intensity: 2373.93 cd

S/MH(C0/C180): 0.96

Total Rated Lamp Lumens: 2582.1 lm

Efficiency: 100%


Upward Ratio: 0%

C0r0 Intensity: 2370.55 cd


Pos of Max. Intensity: H60 V2

S/MH(C90/C270): 0.99

Picture Of Luminaire



Luminous Intensity Distribution Curve

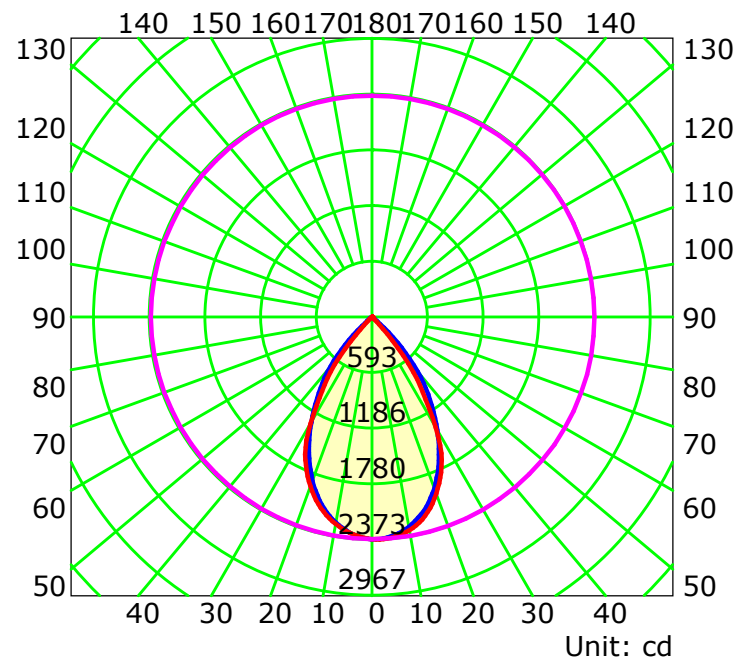

Average Diffuse Angle(50%): 64.1°

— C0-C180 — C90-C270 — G2

C Plane (°):0.0-360.0: 30.0

Test Lab: MESTER LAB

Test Type: TYPE C

Temperature: 25.5°C

Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0


Test Device: GPM-1800B

Distance: 11.655 m [K=1.0000]

Humidity: 45% R.H

Inspector:


Luminous Intensity Distribution Curve

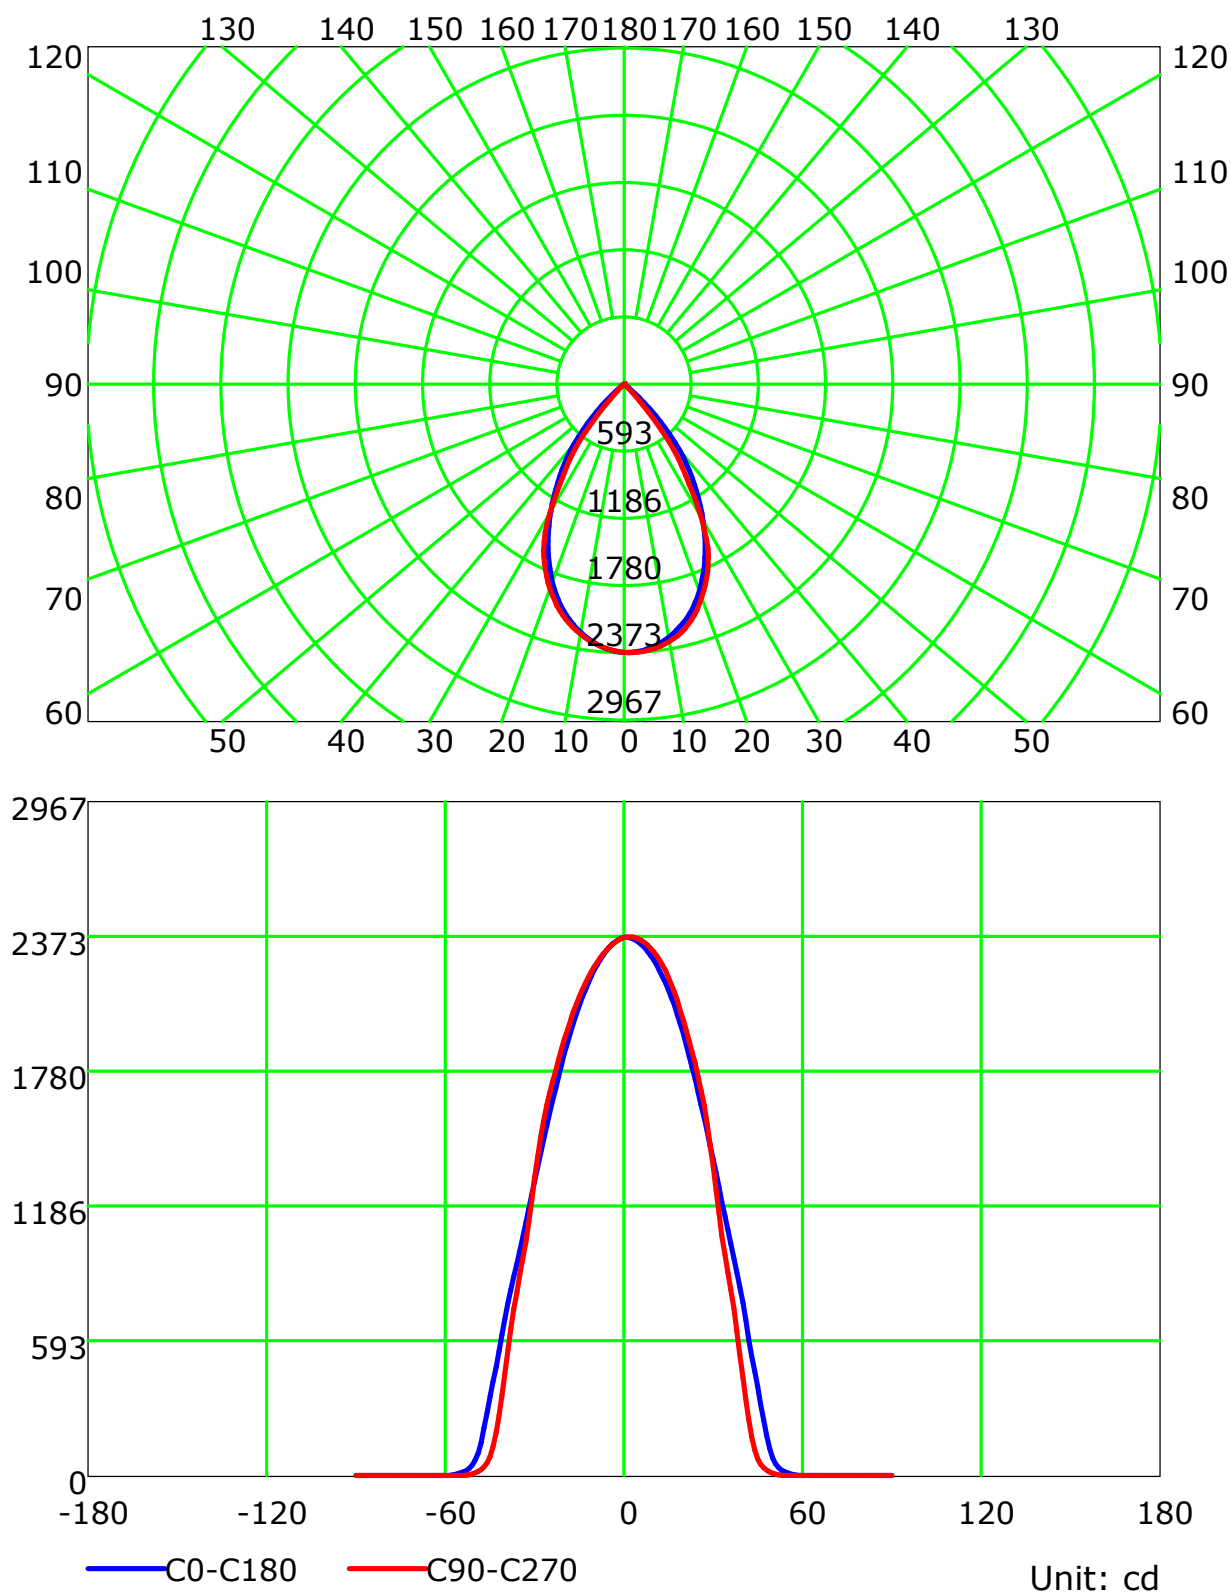

C Plane (°):0.0-360.0: 30.0
Test Lab: MESTER LAB
Test Type: TYPE C
Temperature: 25.5℃
Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:

Luminous Intensity Distribution Curve(cd/klm)

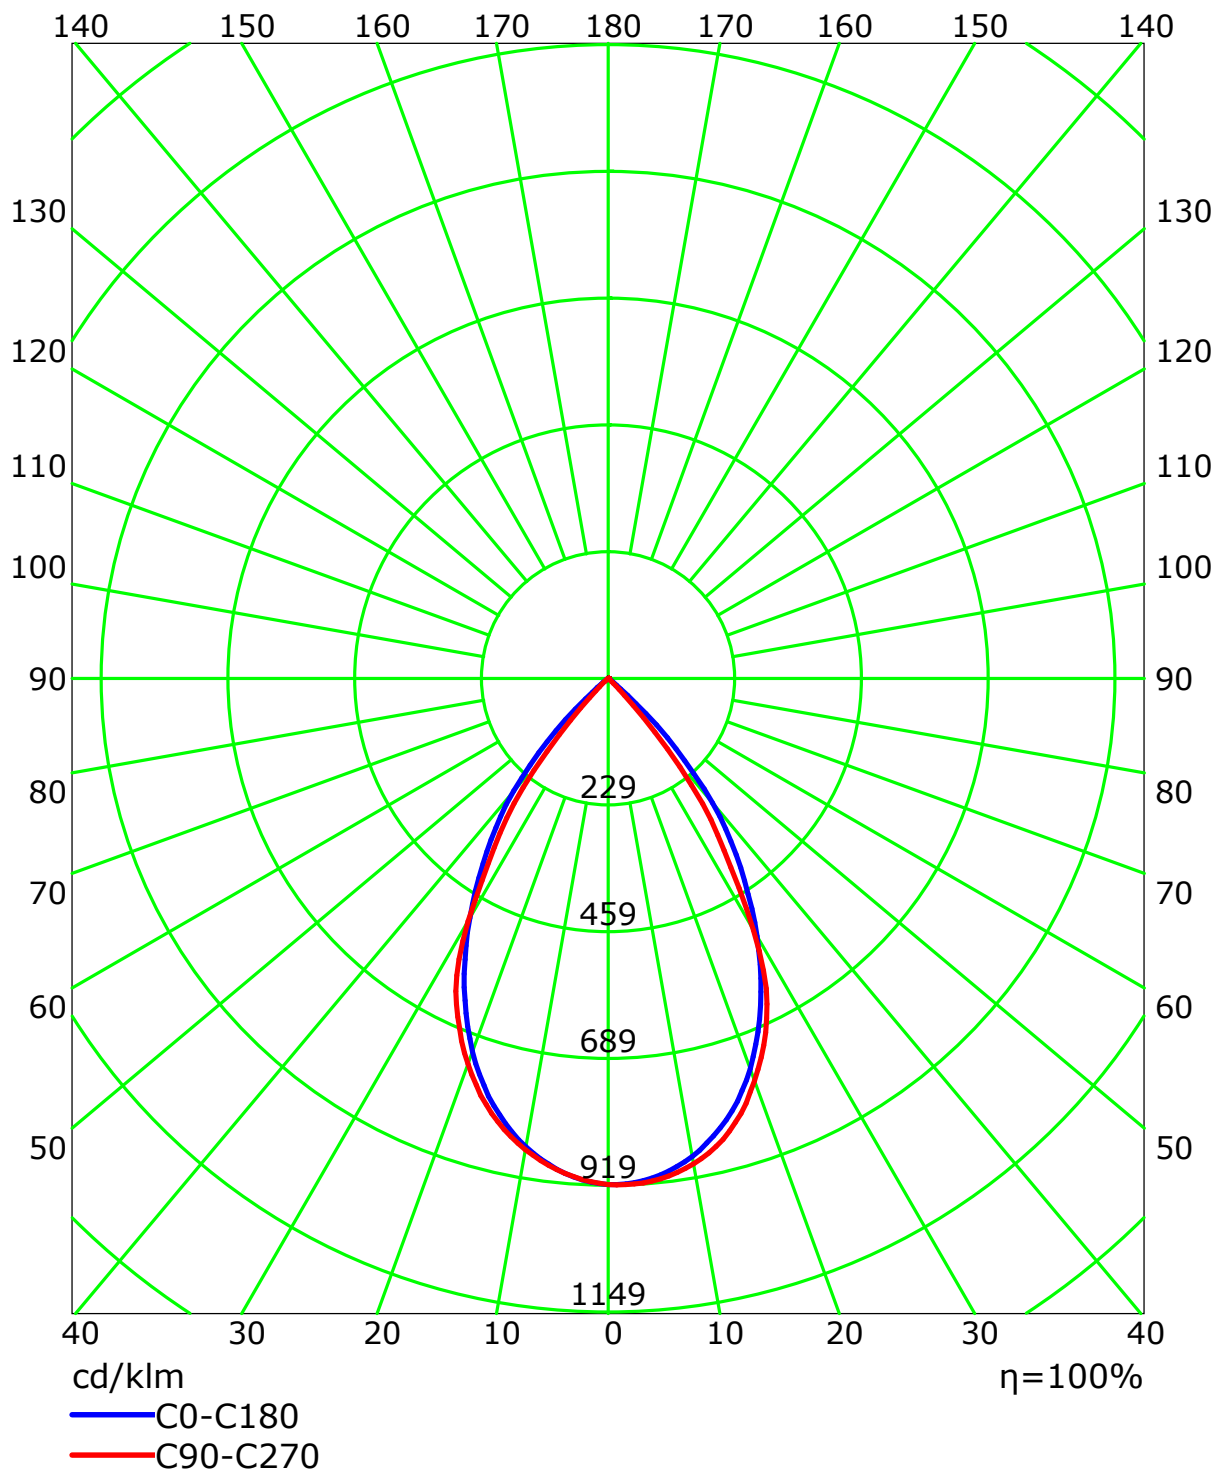

C Plane (°):0.0-360.0: 30.0
Test Lab: MESTER LAB
Test Type: TYPE C
Temperature: 25.5°C
Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:


Coefficients Of Utilization - Zonal Cavity Method

RC	0.8	0.8	0.8	0.8	0.7	0.7	0.7	0.7	0.5	0.5	0.5	0.3	0.3	0.3	0.1	0.1	0.1	0
RW	0.7	0.5	0.3	0.1	0.7	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0.5	0.3	0.1	0
RCR	RF = 0.2																	
0	1.19	1.19	1.19	1.19	1.16	1.16	1.16	1.16	1.11	1.11	1.11	1.06	1.06	1.06	1.02	1.02	1.02	1.00
1	1.13	1.10	1.08	1.06	1.11	1.08	1.06	1.04	1.04	1.02	1.01	1.01	0.99	0.98	0.97	0.96	0.95	0.93
2	1.07	1.02	0.98	0.95	1.05	1.01	0.97	0.94	0.97	0.94	0.92	0.94	0.92	0.90	0.92	0.90	0.88	0.86
3	1.02	0.95	0.90	0.86	1.00	0.94	0.89	0.85	0.91	0.87	0.84	0.88	0.85	0.82	0.86	0.83	0.81	0.79
4	0.96	0.88	0.82	0.78	0.94	0.87	0.82	0.78	0.85	0.80	0.77	0.83	0.79	0.76	0.81	0.78	0.75	0.73
5	0.91	0.82	0.76	0.71	0.89	0.81	0.75	0.71	0.79	0.74	0.71	0.78	0.73	0.70	0.76	0.72	0.69	0.68
6	0.86	0.77	0.70	0.66	0.84	0.76	0.70	0.66	0.74	0.69	0.65	0.73	0.68	0.65	0.71	0.67	0.64	0.63
7	0.81	0.72	0.65	0.61	0.80	0.71	0.65	0.61	0.70	0.64	0.60	0.68	0.64	0.60	0.67	0.63	0.60	0.58
8	0.77	0.67	0.61	0.56	0.76	0.66	0.60	0.56	0.65	0.60	0.56	0.64	0.59	0.56	0.63	0.59	0.56	0.54
9	0.73	0.63	0.57	0.52	0.72	0.62	0.56	0.52	0.61	0.56	0.52	0.60	0.56	0.52	0.60	0.55	0.52	0.50
10	0.69	0.59	0.53	0.49	0.68	0.59	0.53	0.49	0.58	0.52	0.49	0.57	0.52	0.49	0.56	0.52	0.48	0.47

Spacing Criteria (0-180): 0.96

Spacing Criteria (90-270): 0.99


Spacing Criteria (Diagonal): 1.01

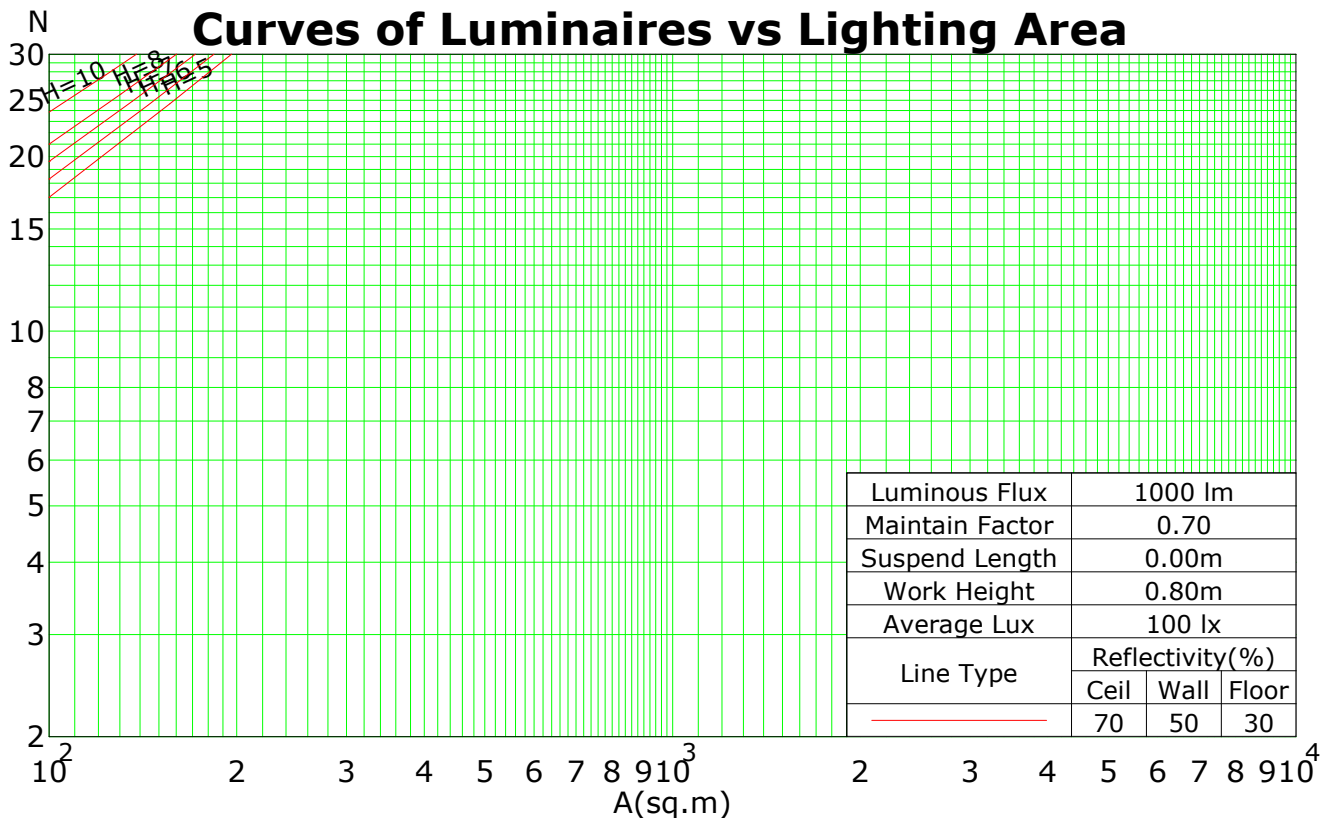

C Plane (°):0.0-360.0: 30.0
Test Lab: MESTER LAB
Test Type: TYPE C
Temperature: 25.5℃
Operator: Yanzhao Sun


Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:

Isocandela (rectangle)

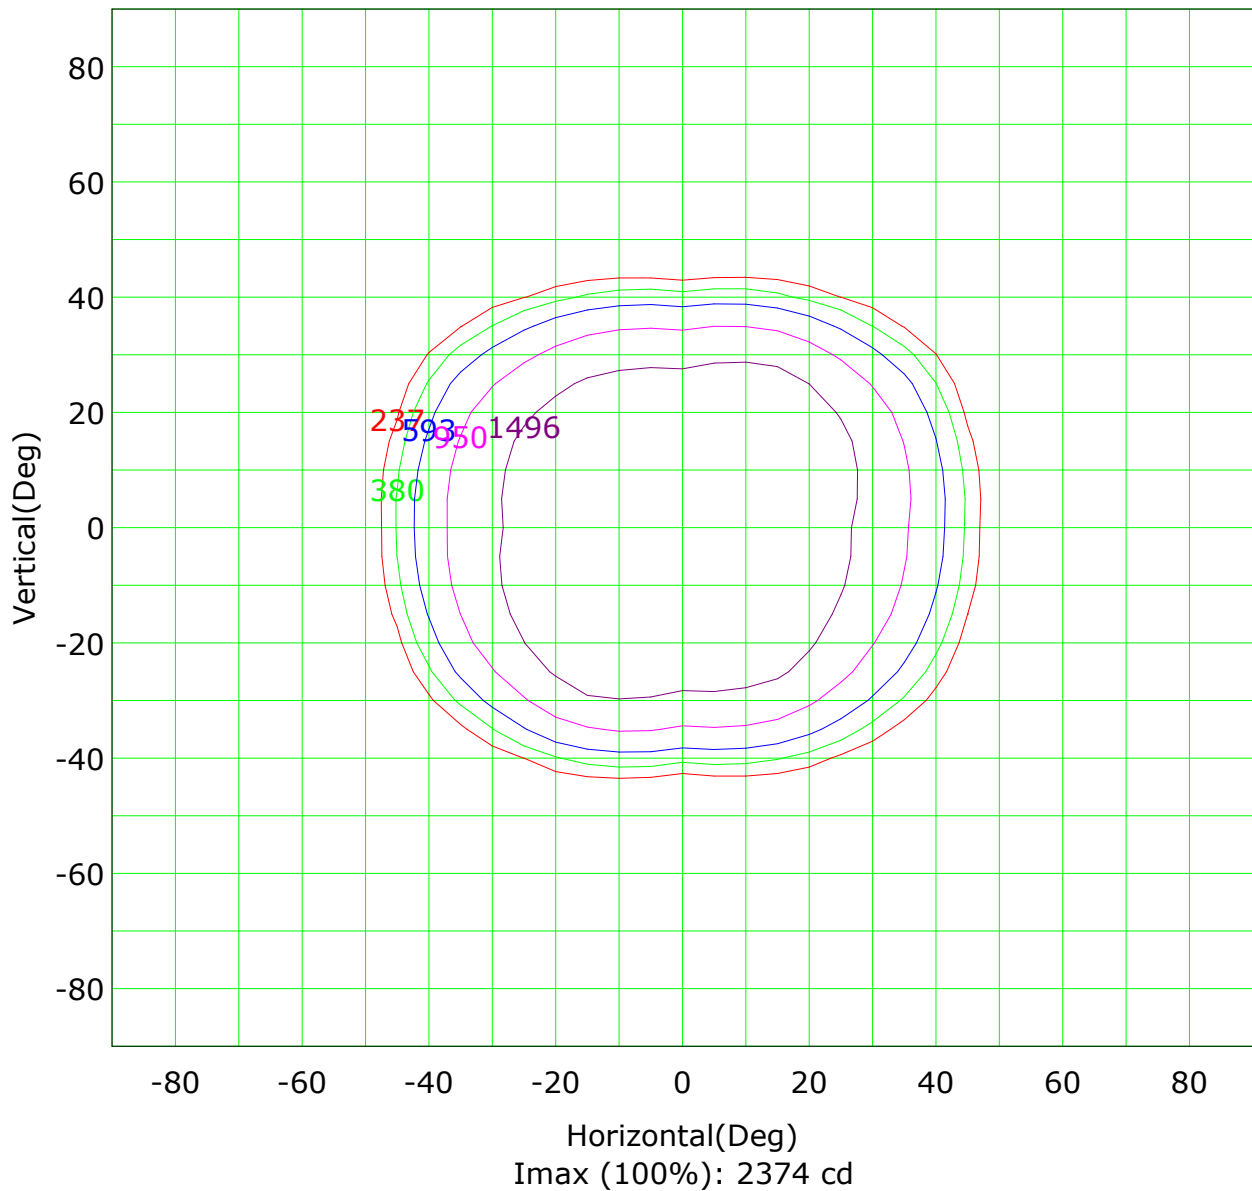

(10%): 237 cd	(16%): 380 cd
(25%): 593 cd	(40%): 950 cd
(63%): 1496 cd	(100%): 2374 cd

Isocandela (sphere)

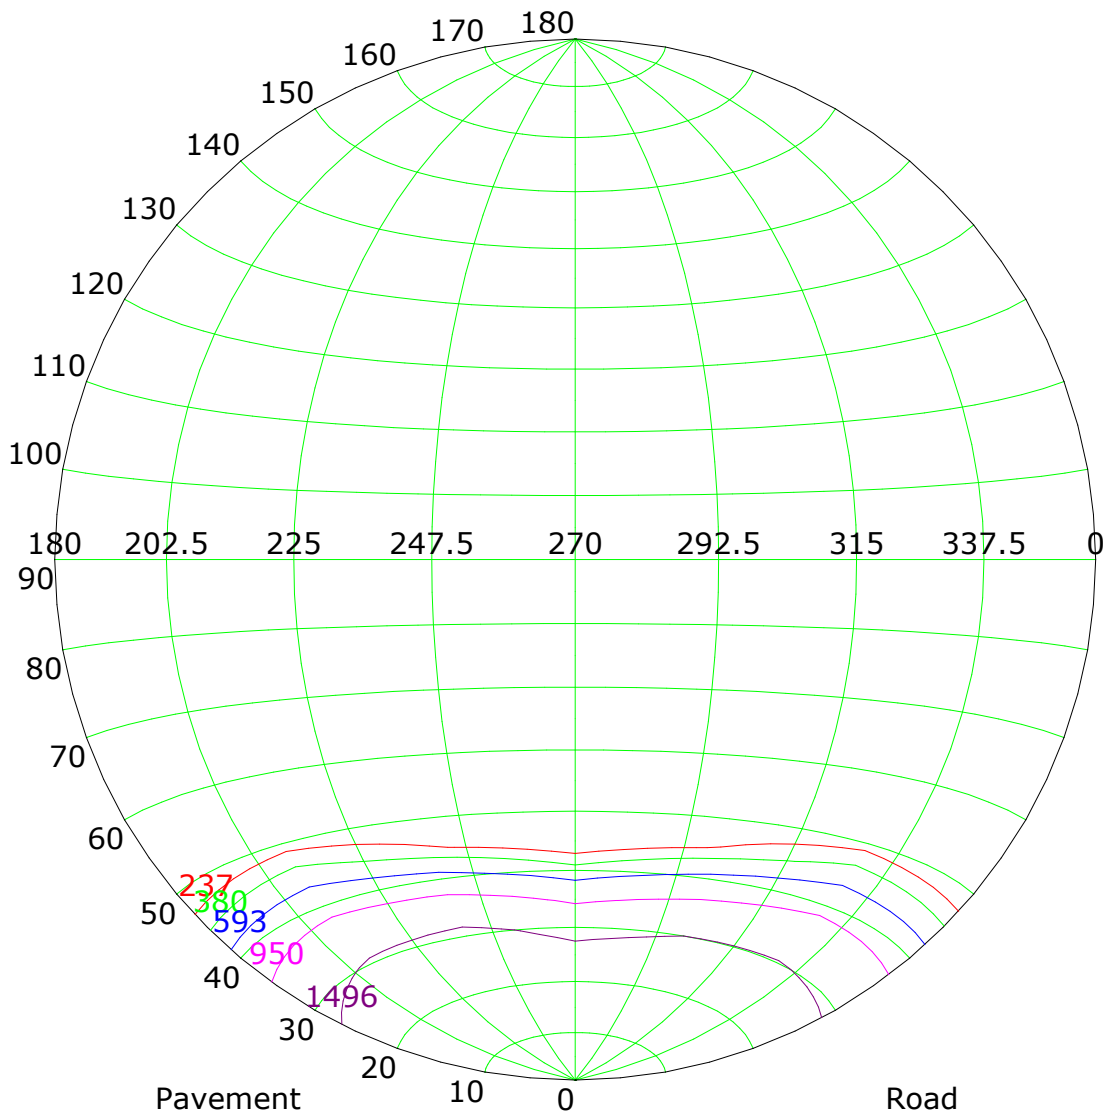

Imax (100%): 2374 cd


(10%): 237 cd
(25%): 593 cd
(63%): 1496 cd

(16%): 380 cd
(40%): 950 cd
(100%): 2374 cd

CIE: narrow - short
CIE: Full-cut-off luminaire
Max.At90: 0.000 cd/klm

IES: Cut-off
Max.At80: 0.000 cd/klm
Max.80-90: 0.000 cd/klm

IsoLux Plot

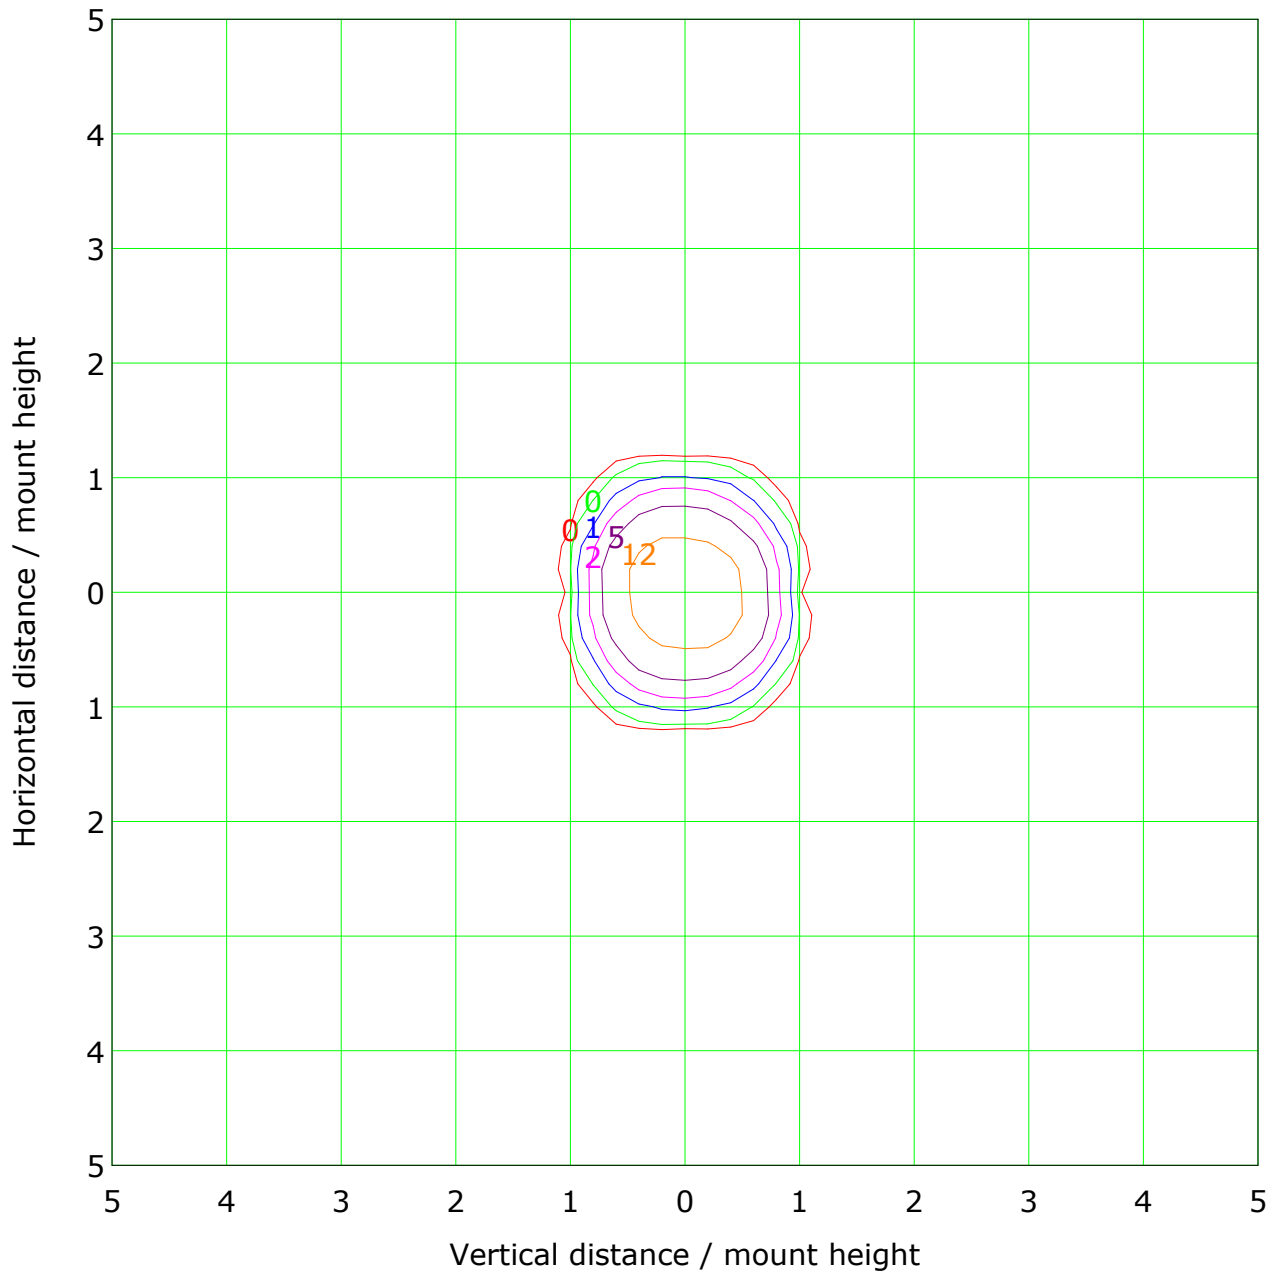

Mounting Height: 10.0m Max Lux(100%): 23.7 lx


(1%): 0.2 lx	(2%): 0.5 lx
(5%): 1.2 lx	(10%): 2.4 lx
(20%): 4.7 lx	(50%): 11.9 lx
(100%): 23.7 lx	

C Plane (°):0.0-360.0: 30.0
Test Lab: MESTER LAB
Test Type: TYPE C
Temperature: 25.5℃
Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:

Roadway CU Curve



Efficiency(%)

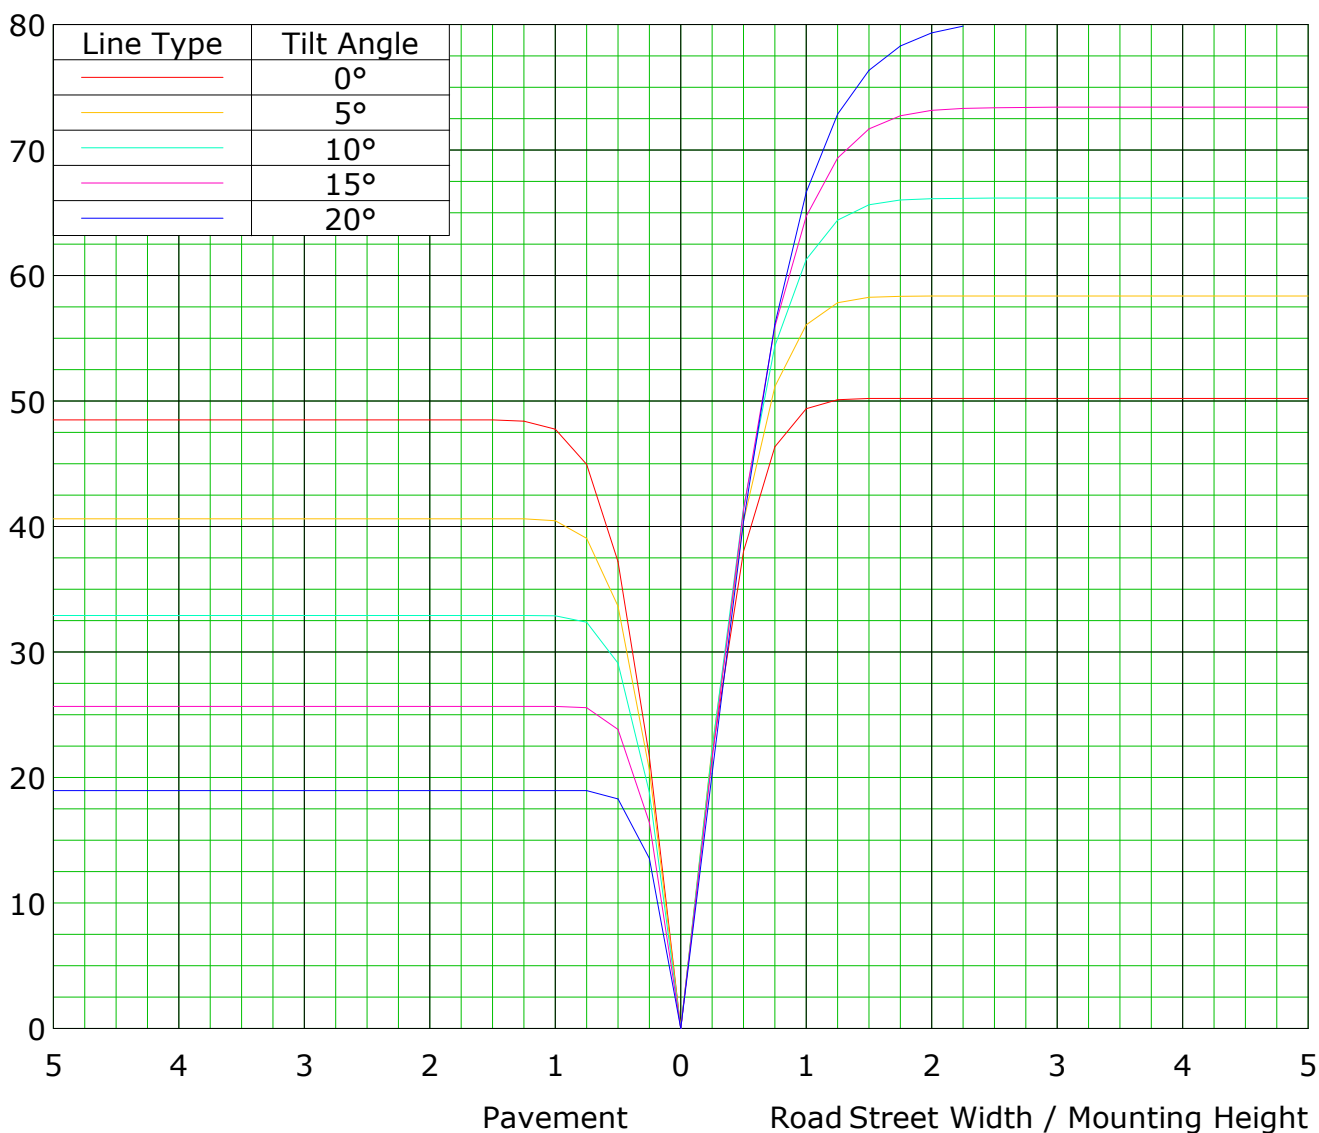

Lum Limit Curve

Dazzle	Quality	Illuminance (lx)							
1.15	A	2000	1000	500	<=300				
1.50	B		2000	1000	500	<=300			
1.85	C			2000	1000	500	<=300		
2.20	D				2000	1000	500	<=300	
2.55	E					2000	1000	500	<=300

a b c d e f g h

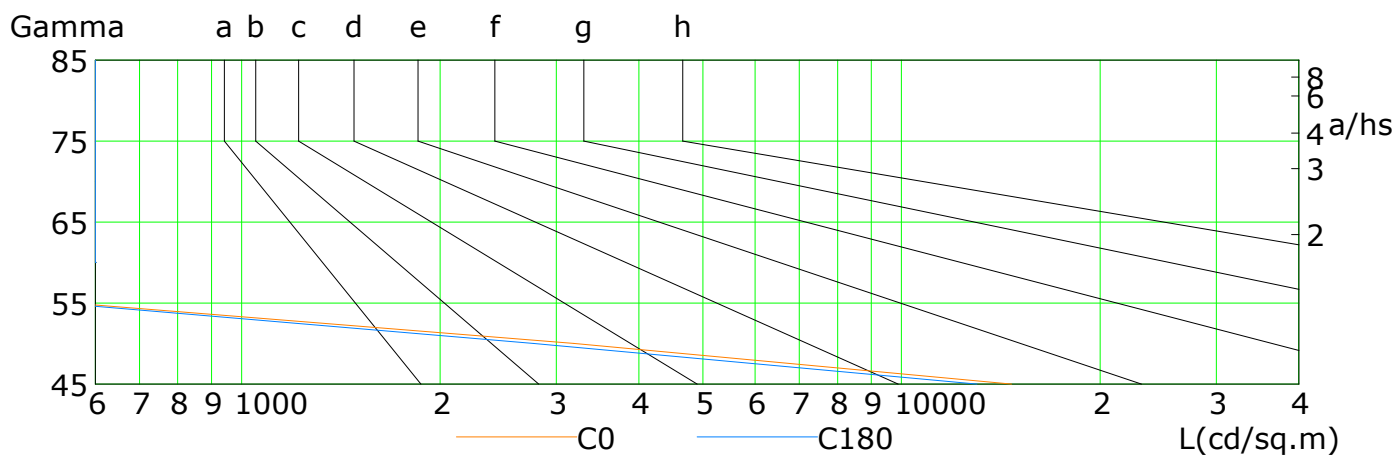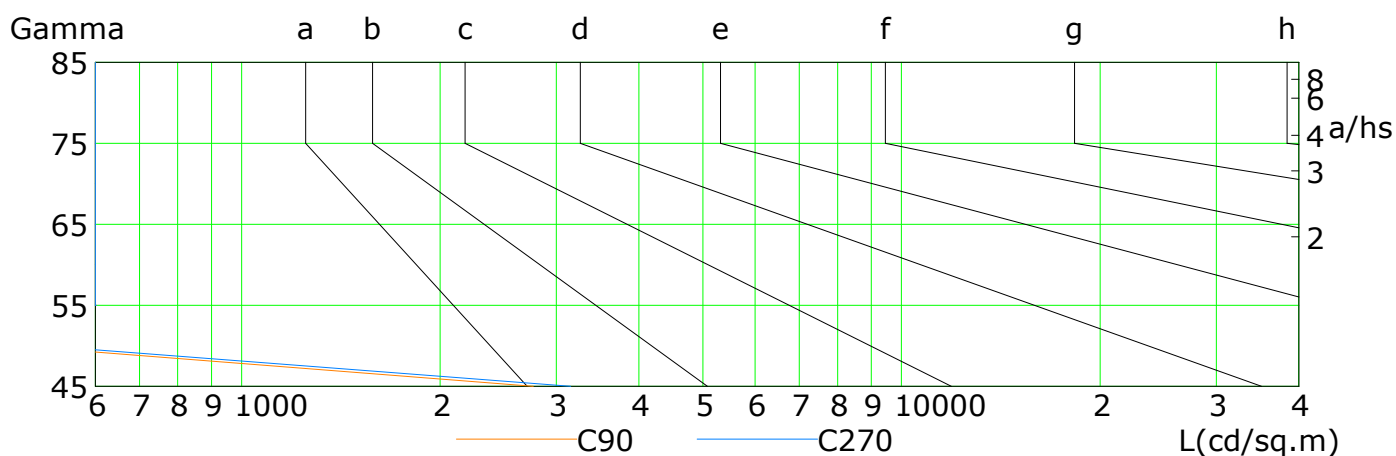


L(cd/sq.m)	G45	G50	G55	G60	G65	G70	G75	G80	G85
C0	14676	3189	559	0	0	0	0	0	0
C90	2767	455	0	0	0	0	0	0	0
C180	13004	2766	527	0	0	0	0	0	0
C270	3152	498	0	0	0	0	0	0	0


C Plane (°):0.0-360.0: 30.0
Test Lab: MESTER LAB
Test Type: TYPE C
Temperature: 25.5℃
Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:

Illuminance at a Distance

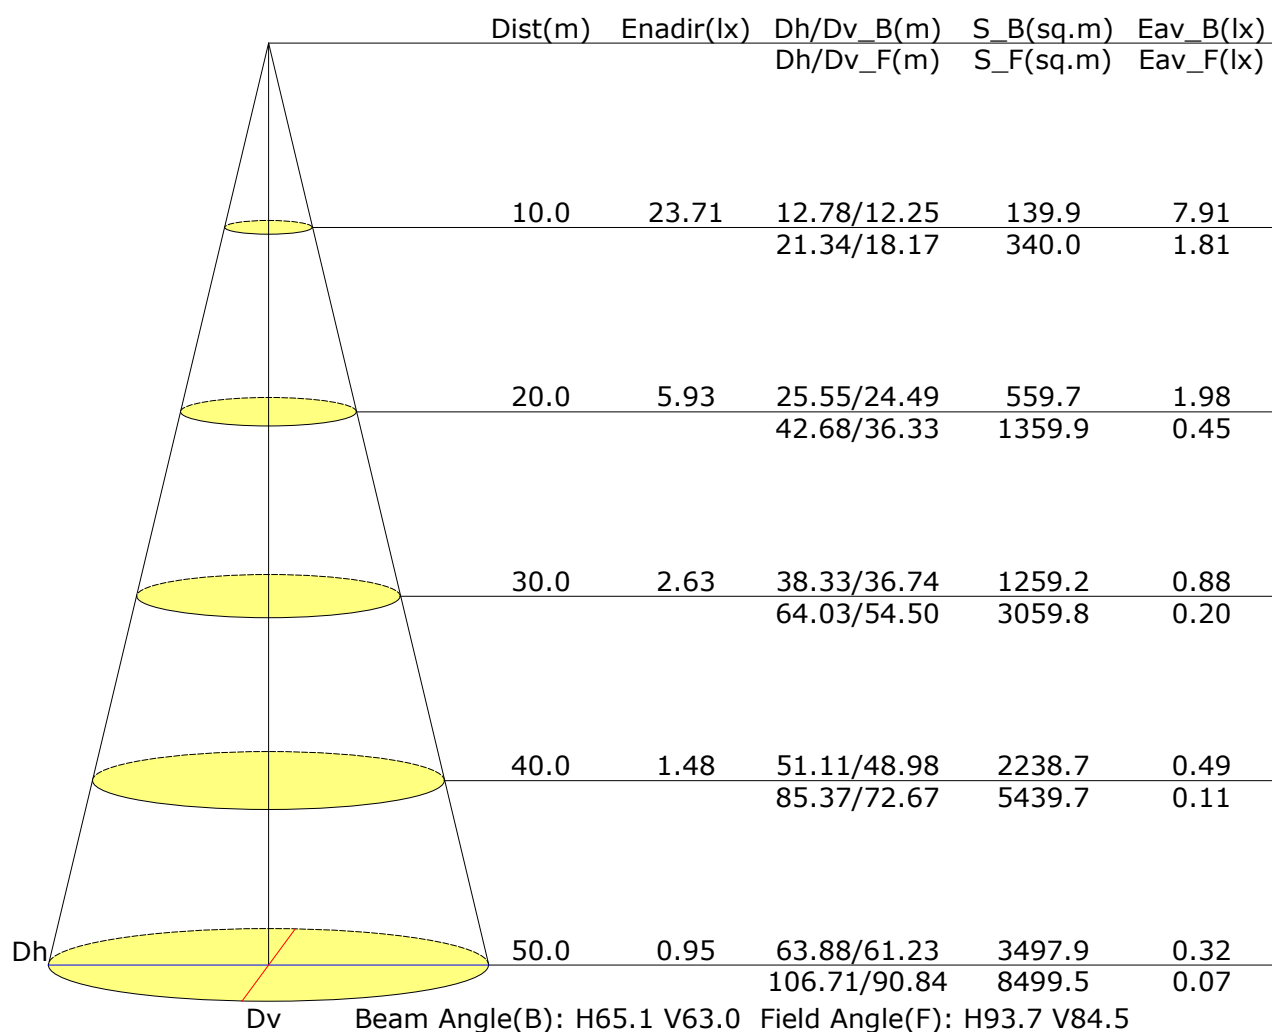

Vertical IsoLux Plot

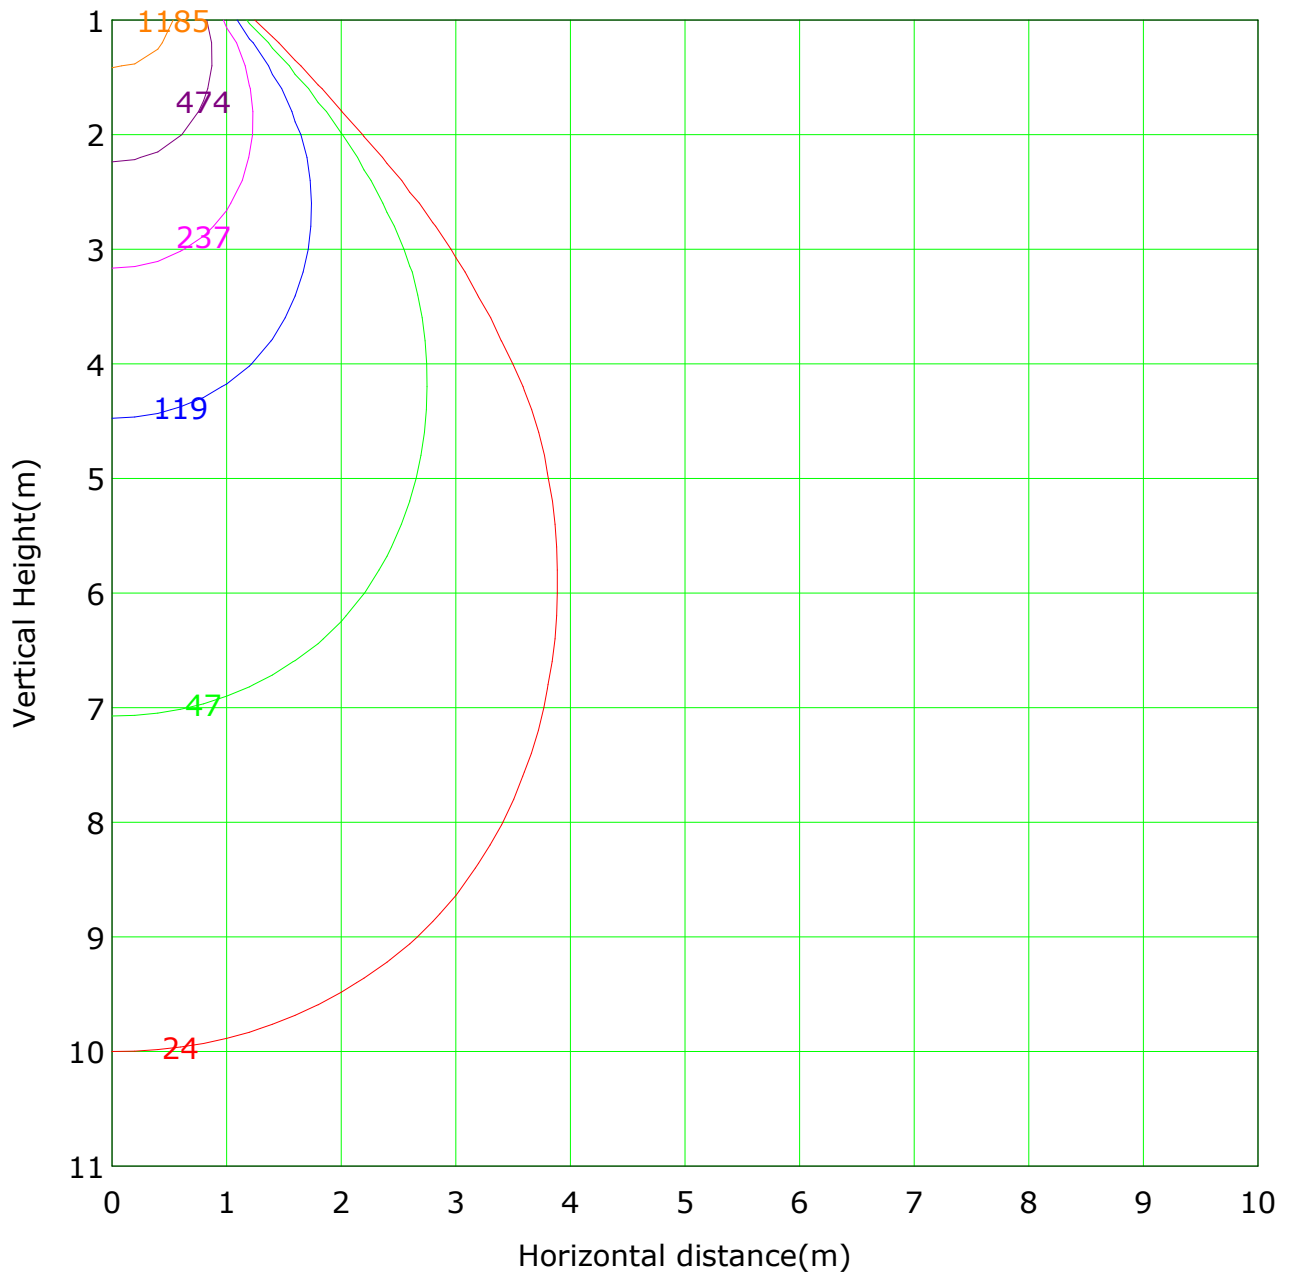


Lowest(m): 1.0m Highest(m): 11.0m Max Lux: 2370.6 lx
— (1%): 23.7 lx — (2%): 47.4 lx
— (5%): 118.5 lx — (10%): 237.1 lx
— (20%): 474.1 lx — (50%): 1185.3 lx
— (100%): 2370.5 lx

Horizontal plane

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:

The Average Illuminance Effective Figure

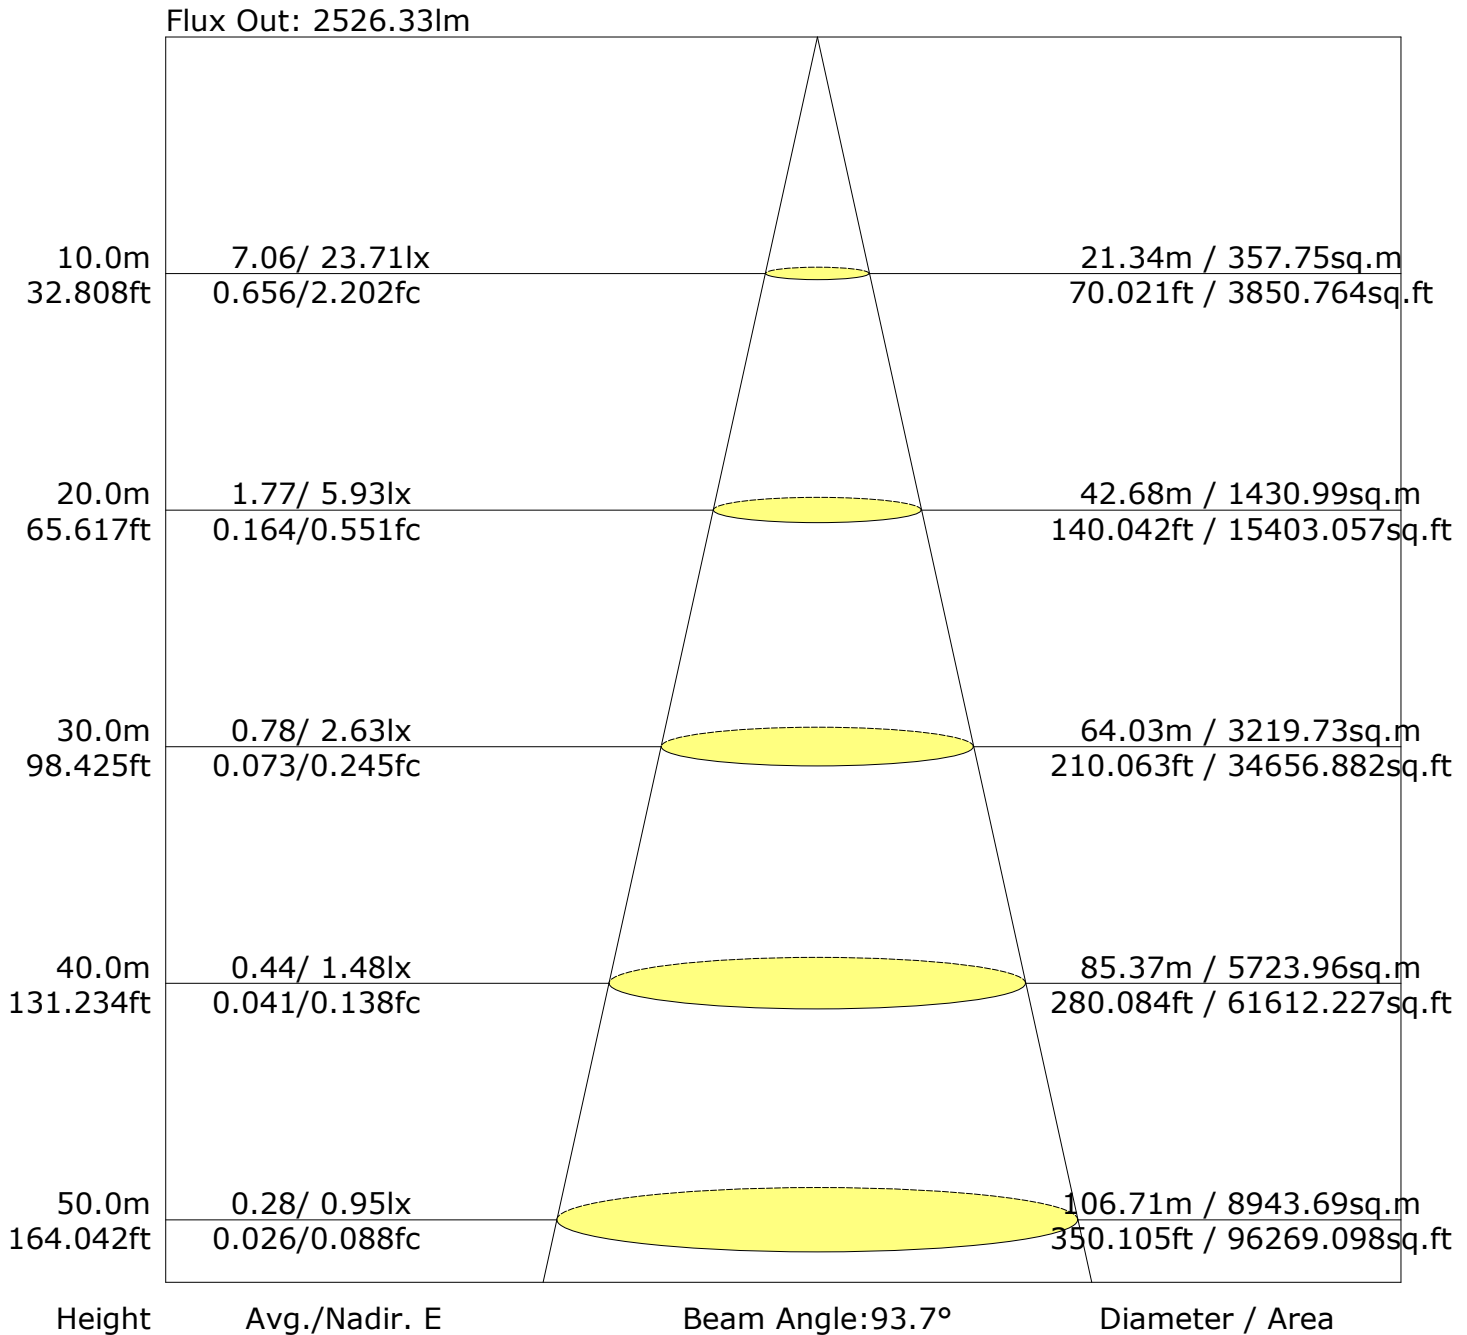

UGR Table

Reflectance:										
Ceiling (cavity)	0.7	0.7	0.5	0.5	0.3	0.7	0.7	0.5	0.5	0.3
Wall	0.5	0.3	0.5	0.3	0.3	0.5	0.3	0.5	0.3	0.3
Reference plane	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Room dimensions	Viewed crosswise					Viewed endwise				
X=2H Y=2H	-2.2	-1.2	-1.8	-0.9	-0.6	-30.0	-29.0	-29.6	-28.7	-28.4
3H	-2.4	-1.5	-2.0	-1.2	-0.8	-30.2	-29.3	-29.8	-29.0	-28.6
4H	-2.5	-1.7	-2.1	-1.3	-0.9	-30.3	-29.5	-29.9	-29.1	-28.8
6H	-2.6	-1.9	-2.2	-1.5	-1.1	-30.4	-29.7	-30.0	-29.3	-28.9
8H	-2.7	-2.0	-2.2	-1.6	-1.2	-30.5	-29.8	-30.0	-29.4	-29.0
12H	-2.7	-2.1	-2.3	-1.7	-1.2	-30.5	-29.9	-30.1	-29.5	-29.1
X=4H Y=2H	-2.5	-1.7	-2.1	-1.3	-0.9	-30.3	-29.5	-29.9	-29.1	-28.8
3H	-2.7	-2.1	-2.3	-1.6	-1.2	-30.5	-29.9	-30.1	-29.4	-29.0
4H	-2.8	-2.2	-2.4	-1.8	-1.4	-30.6	-30.0	-30.2	-29.6	-29.2
6H	-2.9	-2.4	-2.5	-2.0	-1.5	-30.7	-30.2	-30.3	-29.8	-29.3
8H	-3.0	-2.6	-2.5	-2.1	-1.6	-30.8	-30.4	-30.3	-29.9	-29.4
12H	-3.1	-2.7	-2.6	-2.2	-1.7	-30.9	-30.5	-30.4	-30.0	-29.5
X=8H Y=4H	-3.0	-2.6	-2.5	-2.1	-1.6	-30.8	-30.4	-30.3	-29.9	-29.4
6H	-3.1	-2.8	-2.6	-2.3	-1.8	-30.9	-30.6	-30.4	-30.1	-29.6
8H	-3.2	-2.9	-2.7	-2.4	-1.9	-31.0	-30.7	-30.5	-30.2	-29.7
12H	-3.3	-3.0	-2.8	-2.5	-1.9	-31.1	-30.8	-30.6	-30.3	-29.7
X=12H Y=4H	-3.1	-2.7	-2.6	-2.2	-1.7	-30.9	-30.5	-30.4	-30.0	-29.5
6H	-3.2	-2.9	-2.7	-2.4	-1.9	-31.0	-30.7	-30.5	-30.2	-29.7
8H	-3.3	-3.0	-2.8	-2.5	-1.9	-31.1	-30.8	-30.6	-30.3	-29.7

Calculate in accordance with CIE 190:2010 The table is revised with 2582lm ($8\log(F/F_0) = 3.3$).

C Plane (°):0.0-360.0: 30.0
 Test Lab: MESTER LAB
 Test Type: TYPE C
 Temperature: 25.5°C
 Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
 Test Device: GPM-1800B
 Distance: 11.655 m [K=1.0000]
 Humidity: 45% R.H
 Inspector:

FLUX DISTRIBUTION TABLE BASED ON THE IESNA LUMINAIRE CLASSIFICATION SYSTEM


	ZONE	LUMENS	% LAMP LUMENS
	FORWARD LIGHT	1314	50.9
	FL (0°-30°)	828	32.1
	FM (30°-60°)	485	18.8
	FH (60°-80°)	0	0.0
	FVH (80°-90°)	0	0.0
	BACK LIGHT	1268	49.1
	BL (0°-30°)	811	31.4
	BM (30°-60°)	457	17.7
	BH (60°-80°)	0	0.0
	BVH (80°-90°)	0	0.0
	UP LIGHT	0	0.0
	UL (90°-100°)	0	0.0
	UH (100°-180°)	0	0.0
	TRAPPED LIGHT	NA	NA

BUG(Backlight,Uplight,Glare) Rating Base On TM-15-07	
Asymmetrical Luminaire Types (Type I,II,III,IV)	B2 U0 G0
Quadrilateral Symmetrical Luminaire Types (Type V,Area Light)	B2 U0 G0

C Plane (°):0.0-360.0: 30.0
Test Lab: MESTER LAB
Test Type: TYPE C
Temperature: 25.5℃
Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:

LCS Graph

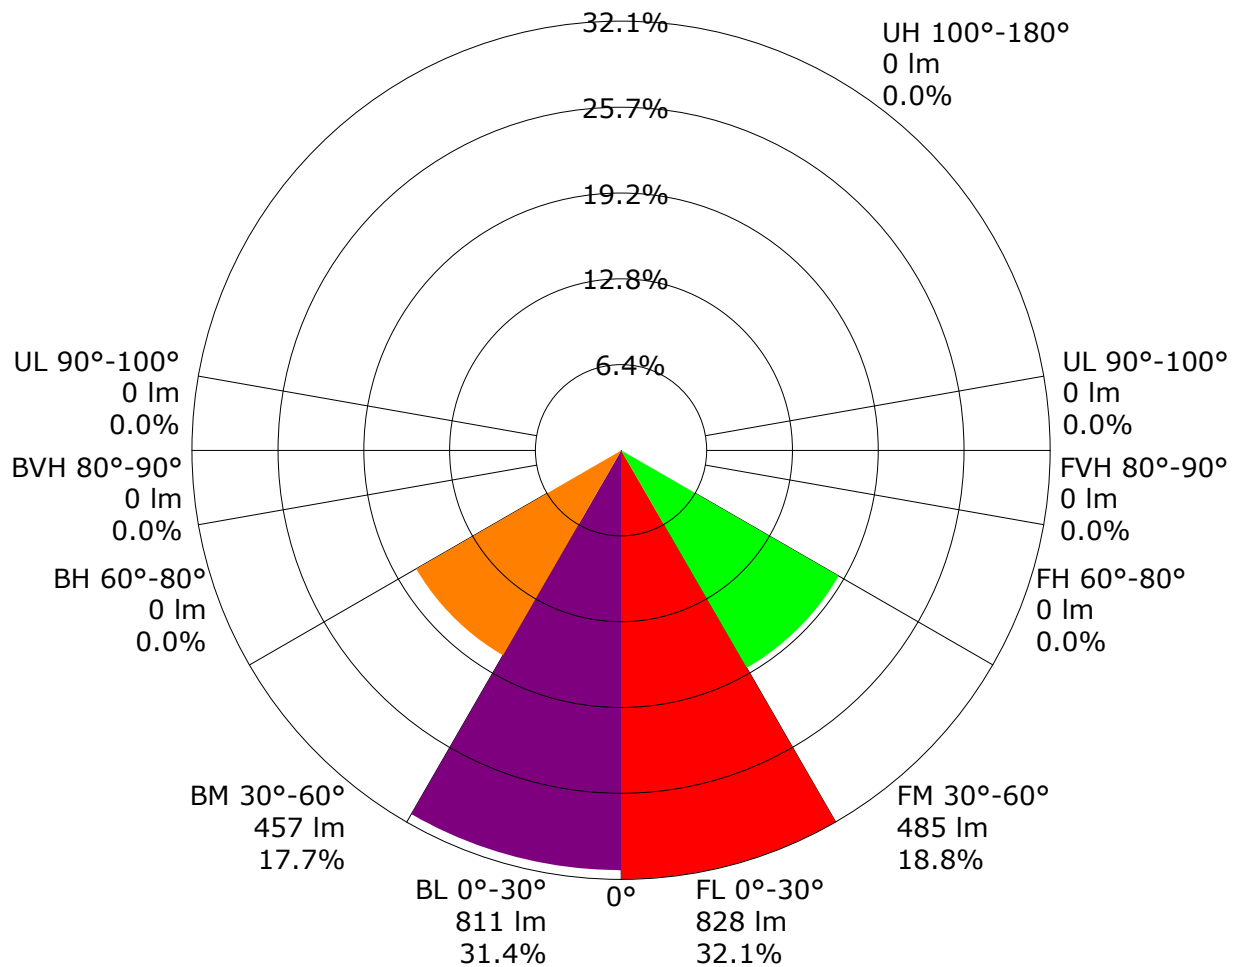

Back Light

Forward Light

Scale= MAX LCS%

Trapped Light:NA,NA

Utilisation Factor Table(Floor cavity)

Utilisation Factors UF(F)			SHR NOM = 1.00									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.83	0.90	0.95	0.98	1.02	1.05	1.07	1.09	1.10	
	0.30		0.78	0.86	0.91	0.94	0.99	1.02	1.04	1.07	1.09	
	0.20		0.75	0.83	0.88	0.91	0.96	0.99	1.02	1.05	1.07	
0.50	0.50	0.20	0.82	0.89	0.93	0.96	0.99	1.02	1.03	1.05	1.06	
	0.30		0.77	0.85	0.89	0.92	0.97	0.99	1.01	1.03	1.05	
	0.20		0.74	0.82	0.87	0.90	0.94	0.97	0.99	1.02	1.04	
0.30	0.50	0.20	0.81	0.87	0.91	0.93	0.97	0.99	1.00	1.02	1.03	
	0.30		0.77	0.84	0.88	0.91	0.95	0.97	0.98	1.00	1.02	
	0.20		0.74	0.81	0.86	0.89	0.93	0.95	0.97	0.99	1.01	
0.00	0.00	0.00	0.72	0.79	0.83	0.86	0.89	0.92	0.93	0.95	0.96	
Rating:21W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Wall)

Utilisation Factors UF(W)			SHR NOM = 1.00									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.60	0.47	0.39	0.34	0.26	0.22	0.18	0.14	0.12	
	0.30		0.50	0.41	0.34	0.30	0.24	0.20	0.17	0.13	0.11	
	0.20		0.43	0.35	0.31	0.27	0.22	0.18	0.16	0.13	0.10	
0.50	0.50	0.20	0.57	0.45	0.37	0.32	0.25	0.24	0.17	0.13	0.10	
	0.30		0.49	0.39	0.33	0.28	0.22	0.19	0.16	0.12	0.10	
	0.20		0.42	0.34	0.29	0.26	0.21	0.17	0.15	0.12	0.10	
0.30	0.50	0.20	0.55	0.42	0.35	0.30	0.23	0.19	0.16	0.12	0.10	
	0.30		0.47	0.37	0.31	0.27	0.21	0.17	0.15	0.11	0.09	
	0.20		0.41	0.33	0.28	0.25	0.20	0.16	0.14	0.11	0.09	
0.00	0.00	0.00	0.28	0.21	0.17	0.14	0.11	0.09	0.07	0.06	0.04	
Rating:21W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Utilisation Factor Table(Ceiling cavity)

Utilisation Factors UF(C)			SHR NOM = 1.00									
Room Reflectance			Room Index(RI)									
Ceiling	Wall	Floor	0.75	1.00	1.25	1.50	2.00	2.50	3.00	4.00	5.00	
0.70	0.50	0.20	0.13	0.14	0.16	0.16	0.18	0.19	0.19	0.20	0.21	
	0.30		0.09	0.11	0.12	0.13	0.15	0.16	0.17	0.19	0.19	
	0.20		0.06	0.08	0.10	0.11	0.13	0.14	0.16	0.17	0.18	
0.50	0.50	0.20	0.13	0.14	0.15	0.16	0.17	0.18	0.19	0.19	0.20	
	0.30		0.09	0.10	0.12	0.13	0.15	0.16	0.17	0.18	0.19	
	0.20		0.06	0.08	0.09	0.11	0.13	0.14	0.15	0.17	0.18	
0.30	0.50	0.20	0.12	0.13	0.15	0.15	0.16	0.17	0.18	0.19	0.19	
	0.30		0.08	0.10	0.12	0.13	0.14	0.15	0.16	0.17	0.18	
	0.20		0.06	0.08	0.09	0.11	0.12	0.14	0.15	0.16	0.17	
0.00	0.00	0.00	NA	NA	NA	NA	NA	NA	NA	NA	NA	
Rating:21W Photometrically tested without ceiling board. Multiply UF values by service correction factors Calculate in accordance with CIBSE Technical Memorandum NO.5 1980												

Zonal Lumen

Gamma [°]	I _{mean} [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
0.0-1.0	2368.4	2.3	2.3	0.09	0.09
1.0-2.0	2365.7	6.8	9.1	0.26	0.35
2.0-3.0	2360.9	11.3	20.4	0.44	0.79
3.0-4.0	2354.1	15.8	36.1	0.61	1.40
4.0-5.0	2345.3	20.2	56.3	0.78	2.18
5.0-6.0	2334.7	24.5	80.8	0.95	3.13
6.0-7.0	2322.3	28.8	109.7	1.12	4.25
7.0-8.0	2308.1	33.0	142.7	1.28	5.53
8.0-9.0	2292.5	37.2	179.9	1.44	6.97
9.0-10.0	2275.8	41.2	221.0	1.60	8.56
10.0-11.0	2257.4	45.1	266.2	1.75	10.31
11.0-12.0	2237.5	48.9	315.1	1.89	12.20
12.0-13.0	2216.7	52.6	367.7	2.04	14.24
13.0-14.0	2195.0	56.2	423.9	2.18	16.42
14.0-15.0	2171.7	59.6	483.5	2.31	18.73
15.0-16.0	2146.7	62.9	546.4	2.44	21.16
16.0-17.0	2120.1	66.0	612.5	2.56	23.72
17.0-18.0	2091.0	69.0	681.4	2.67	26.39
18.0-19.0	2059.0	71.6	753.0	2.77	29.16
19.0-20.0	2024.5	74.1	827.2	2.87	32.03
20.0-21.0	1987.2	76.3	903.5	2.96	34.99
21.0-22.0	1946.8	78.2	981.7	3.03	38.02
22.0-23.0	1904.0	79.9	1061.6	3.09	41.11
23.0-24.0	1858.6	81.3	1142.9	3.15	44.26
24.0-25.0	1809.5	82.3	1225.2	3.19	47.45
25.0-26.0	1757.4	83.0	1308.1	3.21	50.66
26.0-27.0	1702.8	83.3	1391.5	3.23	53.89
27.0-28.0	1644.6	83.3	1474.7	3.23	57.11
28.0-29.0	1582.2	82.8	1557.5	3.21	60.32
29.0-30.0	1514.8	81.8	1639.3	3.17	63.49
30.0-31.0	1442.5	80.3	1719.6	3.11	66.60
31.0-32.0	1367.2	78.3	1798.0	3.03	69.63
32.0-33.0	1289.1	76.0	1873.9	2.94	72.57
33.0-34.0	1207.3	73.1	1947.0	2.83	75.40
34.0-35.0	1124.8	69.9	2016.8	2.71	78.11
35.0-36.0	1044.0	66.5	2083.3	2.57	80.68

C Plane (°):0.0-360.0: 30.0
 Test Lab: MESTER LAB
 Test Type: TYPE C
 Temperature: 25.5℃
 Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
 Test Device: GPM-1800B
 Distance: 11.655 m [K=1.0000]
 Humidity: 45% R.H
 Inspector:

Zonal Lumen (Continue 1)

Gamma [°]	Imean [cd]	Zonal Flux [lm]	Sum Zonal Flux [lm]	Rel Zonal Flux [%]	Sum Rel Zonal Flux [%]
36.0-37.0	964.5	62.9	2146.2	2.44	83.12
37.0-38.0	883.5	59.0	2205.2	2.28	85.40
38.0-39.0	802.4	54.8	2260.0	2.12	87.53
39.0-40.0	721.6	50.3	2310.3	1.95	89.47
40.0-41.0	640.6	45.6	2355.9	1.77	91.24
41.0-42.0	561.0	40.8	2396.7	1.58	92.82
42.0-43.0	482.9	35.8	2432.5	1.39	94.21
43.0-44.0	407.9	30.8	2463.3	1.19	95.40
44.0-45.0	338.9	26.0	2489.3	1.01	96.41
45.0-46.0	276.3	21.6	2510.9	0.84	97.24
46.0-47.0	219.6	17.5	2528.4	0.68	97.92
47.0-48.0	170.4	13.8	2542.2	0.53	98.45
48.0-49.0	129.9	10.7	2552.9	0.41	98.87
49.0-50.0	97.0	8.1	2560.9	0.31	99.18
50.0-51.0	71.1	6.0	2567.0	0.23	99.41
51.0-52.0	51.9	4.5	2571.4	0.17	99.59
52.0-53.0	37.7	3.3	2574.7	0.13	99.71
53.0-54.0	27.2	2.4	2577.1	0.09	99.81
54.0-55.0	19.2	1.7	2578.8	0.07	99.87
55.0-56.0	13.3	1.2	2580.0	0.05	99.92
56.0-57.0	8.7	0.8	2580.8	0.03	99.95
57.0-58.0	5.6	0.5	2581.3	0.02	99.97
58.0-59.0	3.7	0.3	2581.7	0.01	99.98
59.0-60.0	2.4	0.2	2581.9	0.01	99.99
60.0-61.0	1.4	0.1	2582.0	0.01	100.00
61.0-62.0	0.6	0.1	2582.1	0.00	100.00
62.0-63.0	0.1	0.0	2582.1	0.00	100.00
63.0-64.0	0.0	0.0	2582.1	0.00	100.00
64.0-65.0	0.0	0.0	2582.1	0.00	100.00
65.0-66.0	0.0	0.0	2582.1	0.00	100.00
66.0-67.0	0.0	0.0	2582.1	0.00	100.00
67.0-68.0	0.0	0.0	2582.1	0.00	100.00
68.0-69.0	0.0	0.0	2582.1	0.00	100.00
69.0-70.0	0.0	0.0	2582.1	0.00	100.00
70.0-71.0	0.0	0.0	2582.1	0.00	100.00
71.0-72.0	0.0	0.0	2582.1	0.00	100.00

C Plane (°):0.0-360.0: 30.0
Test Lab: MESTER LAB
Test Type: TYPE C
Temperature: 25.5℃
Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:

Zonal Lumen (Continue 3)

cone flux(90°): 2489.33 lm

%lum = 96.4%

%lamp = 96.4%

cone flux(120°): 2581.89 lm

%lum = 100.0%

%lamp = 100.0%

Candlepower Table

Unit: cd

G\C	C0.0	C30.0	C60.0	C90.0	C120.0	C150.0	C180.0	C210.0	C240.0	C270.0
G0.0	2370.6	2371.8	2369.5	2369.6	2367.7	2366.0	2370.6	2371.8	2369.5	2369.6
G1.0	2370.8	2372.9	2372.2	2372.0	2369.6	2364.5	2366.7	2367.4	2363.5	2364.9
G2.0	2368.6	2371.7	2373.9	2372.2	2368.8	2359.8	2359.6	2361.1	2355.4	2357.8
G3.0	2364.2	2369.1	2373.4	2371.2	2365.4	2351.8	2351.3	2352.9	2346.5	2349.5
G4.0	2357.7	2365.4	2371.8	2368.2	2360.0	2342.3	2340.4	2341.7	2336.4	2338.3
G5.0	2348.7	2359.4	2368.8	2362.7	2352.7	2331.1	2327.1	2330.4	2324.6	2326.4
G6.0	2338.0	2351.0	2364.1	2355.6	2343.3	2317.4	2311.6	2317.7	2311.0	2312.6
G7.0	2325.2	2342.2	2357.8	2346.6	2332.1	2299.5	2291.8	2303.7	2297.9	2297.3
G8.0	2308.8	2332.6	2350.6	2336.3	2319.6	2281.9	2272.4	2286.8	2284.0	2280.5
G9.0	2291.8	2322.1	2341.3	2322.3	2304.6	2262.8	2250.4	2271.1	2269.6	2260.5
G10.0	2272.4	2310.5	2331.6	2307.3	2290.1	2241.7	2226.7	2254.3	2255.2	2240.1
G11.0	2250.5	2295.9	2321.6	2290.6	2274.0	2218.6	2200.4	2237.4	2239.0	2217.8
G12.0	2223.8	2281.7	2311.9	2271.3	2256.3	2192.0	2170.0	2220.1	2224.2	2193.8
G13.0	2198.0	2267.4	2300.4	2249.3	2236.1	2165.8	2139.1	2200.8	2209.3	2168.3
G14.0	2169.9	2252.6	2289.0	2225.3	2217.1	2139.1	2106.3	2183.0	2195.4	2138.7
G15.0	2140.5	2234.7	2277.0	2194.6	2193.0	2110.5	2071.5	2164.2	2179.0	2109.0
G16.0	2107.3	2216.7	2263.5	2163.6	2168.8	2075.5	2034.8	2145.0	2164.5	2076.6
G17.0	2071.7	2196.9	2248.4	2129.8	2143.7	2042.3	1992.7	2124.5	2146.4	2042.8
G18.0	2029.8	2173.4	2228.9	2092.1	2115.3	2005.5	1949.9	2099.9	2127.2	2002.7
G19.0	1989.5	2143.7	2207.7	2047.7	2081.3	1966.1	1907.1	2075.2	2107.0	1963.1
G20.0	1945.6	2112.5	2184.7	2005.9	2046.5	1919.1	1860.2	2047.4	2080.5	1921.8
G21.0	1896.3	2076.9	2158.6	1960.4	2007.8	1871.8	1807.5	2016.3	2053.8	1878.3
G22.0	1848.0	2036.9	2125.5	1914.3	1961.3	1823.3	1757.0	1977.5	2024.0	1832.5
G23.0	1798.4	1993.6	2091.2	1866.0	1915.9	1772.4	1704.2	1939.5	1990.3	1781.9
G24.0	1746.5	1945.7	2052.8	1815.5	1867.5	1719.0	1650.6	1896.6	1953.2	1734.0
G25.0	1688.4	1889.2	2008.1	1755.4	1818.2	1663.4	1595.9	1848.7	1908.0	1683.7
G26.0	1633.1	1834.8	1961.7	1697.3	1760.7	1600.7	1539.5	1798.2	1864.3	1630.3
G27.0	1577.4	1775.7	1912.5	1631.5	1705.7	1541.0	1477.2	1738.3	1818.9	1561.8
G28.0	1519.0	1707.5	1858.9	1549.4	1648.2	1480.6	1418.9	1680.9	1768.8	1489.5
G29.0	1453.9	1640.9	1800.9	1461.2	1588.6	1418.1	1360.8	1620.5	1708.3	1405.8
G30.0	1394.1	1572.3	1730.8	1362.6	1523.8	1348.3	1295.8	1556.6	1644.1	1313.6
G31.0	1333.9	1500.6	1659.1	1258.3	1446.0	1281.5	1235.6	1483.1	1571.5	1208.7
G32.0	1272.3	1427.8	1577.5	1157.6	1366.7	1214.2	1174.9	1413.5	1487.3	1115.4
G33.0	1205.0	1344.5	1485.5	1055.2	1280.7	1146.3	1113.8	1341.8	1392.3	1030.3
G34.0	1142.7	1266.3	1368.8	971.9	1186.1	1077.3	1048.3	1268.8	1280.3	954.9
G35.0	1082.1	1188.1	1258.8	894.9	1078.8	1001.4	990.5	1188.0	1174.4	885.5
G36.0	1021.8	1109.2	1147.4	818.8	980.4	933.1	934.2	1114.1	1071.8	808.5

C Plane (°):0.0-360.0: 30.0
Test Lab: MESTER LAB
Test Type: TYPE C
Temperature: 25.5℃
Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:

Candlepower Table (Continue 1)

Unit: cd

G\C	C0.0	C30.0	C60.0	C90.0	C120.0	C150.0	C180.0	C210.0	C240.0	C270.0
G37.0	954.8	1030.4	1041.2	735.1	887.5	866.5	876.5	1040.3	974.0	733.0
G38.0	893.9	945.3	930.5	633.9	791.3	801.7	820.0	965.5	879.9	648.6
G39.0	832.5	869.7	835.6	533.5	709.9	738.3	761.4	890.6	780.3	554.5
G40.0	762.2	795.9	742.1	432.3	629.5	671.4	688.3	813.3	689.1	447.0
G41.0	685.8	722.8	648.5	335.3	551.3	610.8	618.9	744.2	600.9	351.5
G42.0	600.2	650.8	553.3	247.2	470.8	551.8	548.3	677.1	509.1	264.6
G43.0	527.2	578.8	452.1	173.3	390.7	491.8	477.4	609.5	414.2	189.9
G44.0	459.4	499.2	366.1	111.8	307.3	431.3	413.6	534.6	331.8	125.7
G45.0	392.3	427.3	286.2	74.0	238.9	365.4	347.6	465.6	259.1	84.2
G46.0	314.8	358.7	211.0	50.1	181.8	308.7	280.1	397.6	198.1	56.7
G47.0	243.4	295.5	154.8	35.2	131.0	257.0	211.2	328.2	143.3	39.3
G48.0	177.1	232.1	112.3	24.0	97.2	207.2	145.2	269.4	105.8	26.6
G49.0	121.7	181.1	81.2	16.8	71.8	163.2	98.8	215.1	76.7	18.3
G50.0	77.5	137.8	56.7	11.1	53.1	121.7	67.2	167.4	54.3	12.1
G51.0	51.7	103.0	40.9	6.8	38.1	91.7	46.1	126.7	39.1	7.4
G52.0	35.5	74.3	29.3	3.2	27.7	69.5	31.3	95.1	28.0	4.0
G53.0	25.2	54.9	20.4	0.0	19.7	52.6	22.5	68.9	19.6	1.5
G54.0	17.3	39.8	13.0	0.0	13.5	38.0	16.4	51.0	12.7	0.0
G55.0	12.1	28.6	7.7	0.0	7.9	27.9	11.4	36.8	7.1	0.0
G56.0	8.1	20.9	3.9	0.0	4.2	20.2	7.7	26.6	3.3	0.0
G57.0	4.6	14.6	0.0	0.0	1.4	14.1	4.8	18.6	0.0	0.0
G58.0	2.0	10.3	0.0	0.0	0.0	10.0	2.4	13.5	0.0	0.0
G59.0	0.0	6.9	0.0	0.0	0.0	6.8	0.0	9.5	0.0	0.0
G60.0	0.0	4.3	0.0	0.0	0.0	4.2	0.0	6.2	0.0	0.0
G61.0	0.0	1.9	0.0	0.0	0.0	2.0	0.0	3.6	0.0	0.0
G62.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	1.5	0.0	0.0
G63.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G64.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G65.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G66.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G67.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G68.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G69.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G70.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G71.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G72.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0
G73.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

C Plane (°):0.0-360.0: 30.0
 Test Lab: MESTER LAB
 Test Type: TYPE C
 Temperature: 25.5℃
 Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
 Test Device: GPM-1800B
 Distance: 11.655 m [K=1.0000]
 Humidity: 45% R.H
 Inspector:

Candlepower Table (Continue 2)

Unit: cd

[illegible]

C Plane (°):0.0-360.0: 30.0
Test Lab: MESTER LAB
Test Type: TYPE C
Temperature: 25.5°C
Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:

Candlepower Table (Continue 3)

Unit: cd

G\C	C300.0	C330.0	C360.0							
G0.0	2367.7	2366.0	2370.6							
G1.0	2362.9	2364.8	2370.8							
G2.0	2355.4	2360.6	2368.6							
G3.0	2346.4	2354.2	2364.2							
G4.0	2335.1	2344.8	2357.7							
G5.0	2320.2	2333.0	2348.7							
G6.0	2305.3	2319.8	2338.0							
G7.0	2288.2	2304.4	2325.2							
G8.0	2269.7	2285.1	2308.8							
G9.0	2250.2	2266.2	2291.8							
G10.0	2229.4	2246.0	2272.4							
G11.0	2204.4	2223.2	2250.5							
G12.0	2180.9	2201.5	2223.8							
G13.0	2157.2	2180.5	2198.0							
G14.0	2132.6	2157.7	2169.9							
G15.0	2105.6	2135.4	2140.5							
G16.0	2079.0	2111.6	2107.3							
G17.0	2053.2	2084.1	2071.7							
G18.0	2024.7	2057.4	2029.8							
G19.0	1992.4	2028.0	1989.5							
G20.0	1959.8	1996.4	1945.6							
G21.0	1925.5	1959.4	1896.3							
G22.0	1888.8	1922.7	1848.0							
G23.0	1848.0	1883.0	1798.4							
G24.0	1800.3	1840.6	1746.5							
G25.0	1755.6	1790.2	1688.4							
G26.0	1710.5	1741.6	1633.1							
G27.0	1664.6	1690.6	1577.4							
G28.0	1615.3	1637.6	1519.0							
G29.0	1556.1	1583.1	1453.9							
G30.0	1493.6	1520.8	1394.1							
G31.0	1423.4	1461.2	1333.9							
G32.0	1343.9	1399.1	1272.3							
G33.0	1257.5	1335.3	1205.0							
G34.0	1159.0	1262.7	1142.7							
G35.0	1069.8	1195.2	1082.1							
G36.0	984.0	1126.0	1021.8							

C Plane (°):0.0-360.0: 30.0
 Test Lab: MESTER LAB
 Test Type: TYPE C
 Temperature: 25.5℃
 Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
 Test Device: GPM-1800B
 Distance: 11.655 m [K=1.0000]
 Humidity: 45% R.H
 Inspector:

Candlepower Table (Continue 4)

Unit: cd

G\C	C300.0	C330.0	C360.0						
G37.0	902.8	1055.9	954.8						
G38.0	816.2	978.2	893.9						
G39.0	739.0	906.2	832.5						
G40.0	659.1	836.7	762.2						
G41.0	570.3	767.7	685.8						
G42.0	484.7	699.1	600.2						
G43.0	402.6	624.3	527.2						
G44.0	323.5	554.1	459.4						
G45.0	252.8	481.6	392.3						
G46.0	187.9	410.2	314.8						
G47.0	140.2	335.7	243.4						
G48.0	104.2	274.6	177.1						
G49.0	76.7	220.1	121.7						
G50.0	54.6	173.1	77.5						
G51.0	39.3	130.0	51.7						
G52.0	27.7	99.5	35.5						
G53.0	19.1	76.1	25.2						
G54.0	11.6	57.9	17.3						
G55.0	6.6	43.2	12.1						
G56.0	2.7	31.2	8.1						
G57.0	0.0	22.4	4.6						
G58.0	0.0	16.2	2.0						
G59.0	0.0	11.1	0.0						
G60.0	0.0	7.5	0.0						
G61.0	0.0	4.3	0.0						
G62.0	0.0	1.8	0.0						
G63.0	0.0	0.0	0.0						
G64.0	0.0	0.0	0.0						
G65.0	0.0	0.0	0.0						
G66.0	0.0	0.0	0.0						
G67.0	0.0	0.0	0.0						
G68.0	0.0	0.0	0.0						
G69.0	0.0	0.0	0.0						
G70.0	0.0	0.0	0.0						
G71.0	0.0	0.0	0.0						
G72.0	0.0	0.0	0.0						
G73.0	0.0	0.0	0.0						

C Plane (°):0.0-360.0: 30.0
 Test Lab: MESTER LAB
 Test Type: TYPE C
 Temperature: 25.5℃
 Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
 Test Device: GPM-1800B
 Distance: 11.655 m [K=1.0000]
 Humidity: 45% R.H
 Inspector:

Candlepower Table (Continue 5)

Unit: cd

[illegible]

C Plane (°):0.0-360.0: 30.0
Test Lab: MESTER LAB
Test Type: TYPE C
Temperature: 25.5°C
Operator: Yanzhao Sun

Gamma Plane (°):0.0-90.0:1.0
Test Device: GPM-1800B
Distance: 11.655 m [K=1.0000]
Humidity: 45% R.H
Inspector:

LED Average Luminance Report

Avg.L	cd/m ²
L 0-180(65) av	0.00
L 0-180(75) av	0.00
L 0-180(85) av	0.00
L 90-270(65) av	0.00
L 90-270(75) av	0.00
L 90-270(85) av	0.00
L 45(65) av	0.00
L 45(75) av	0.00
L 45(85) av	0.00

Standard: GB/T 29293-2012